TYPICAL ITS INTERSECTION LAYOUT

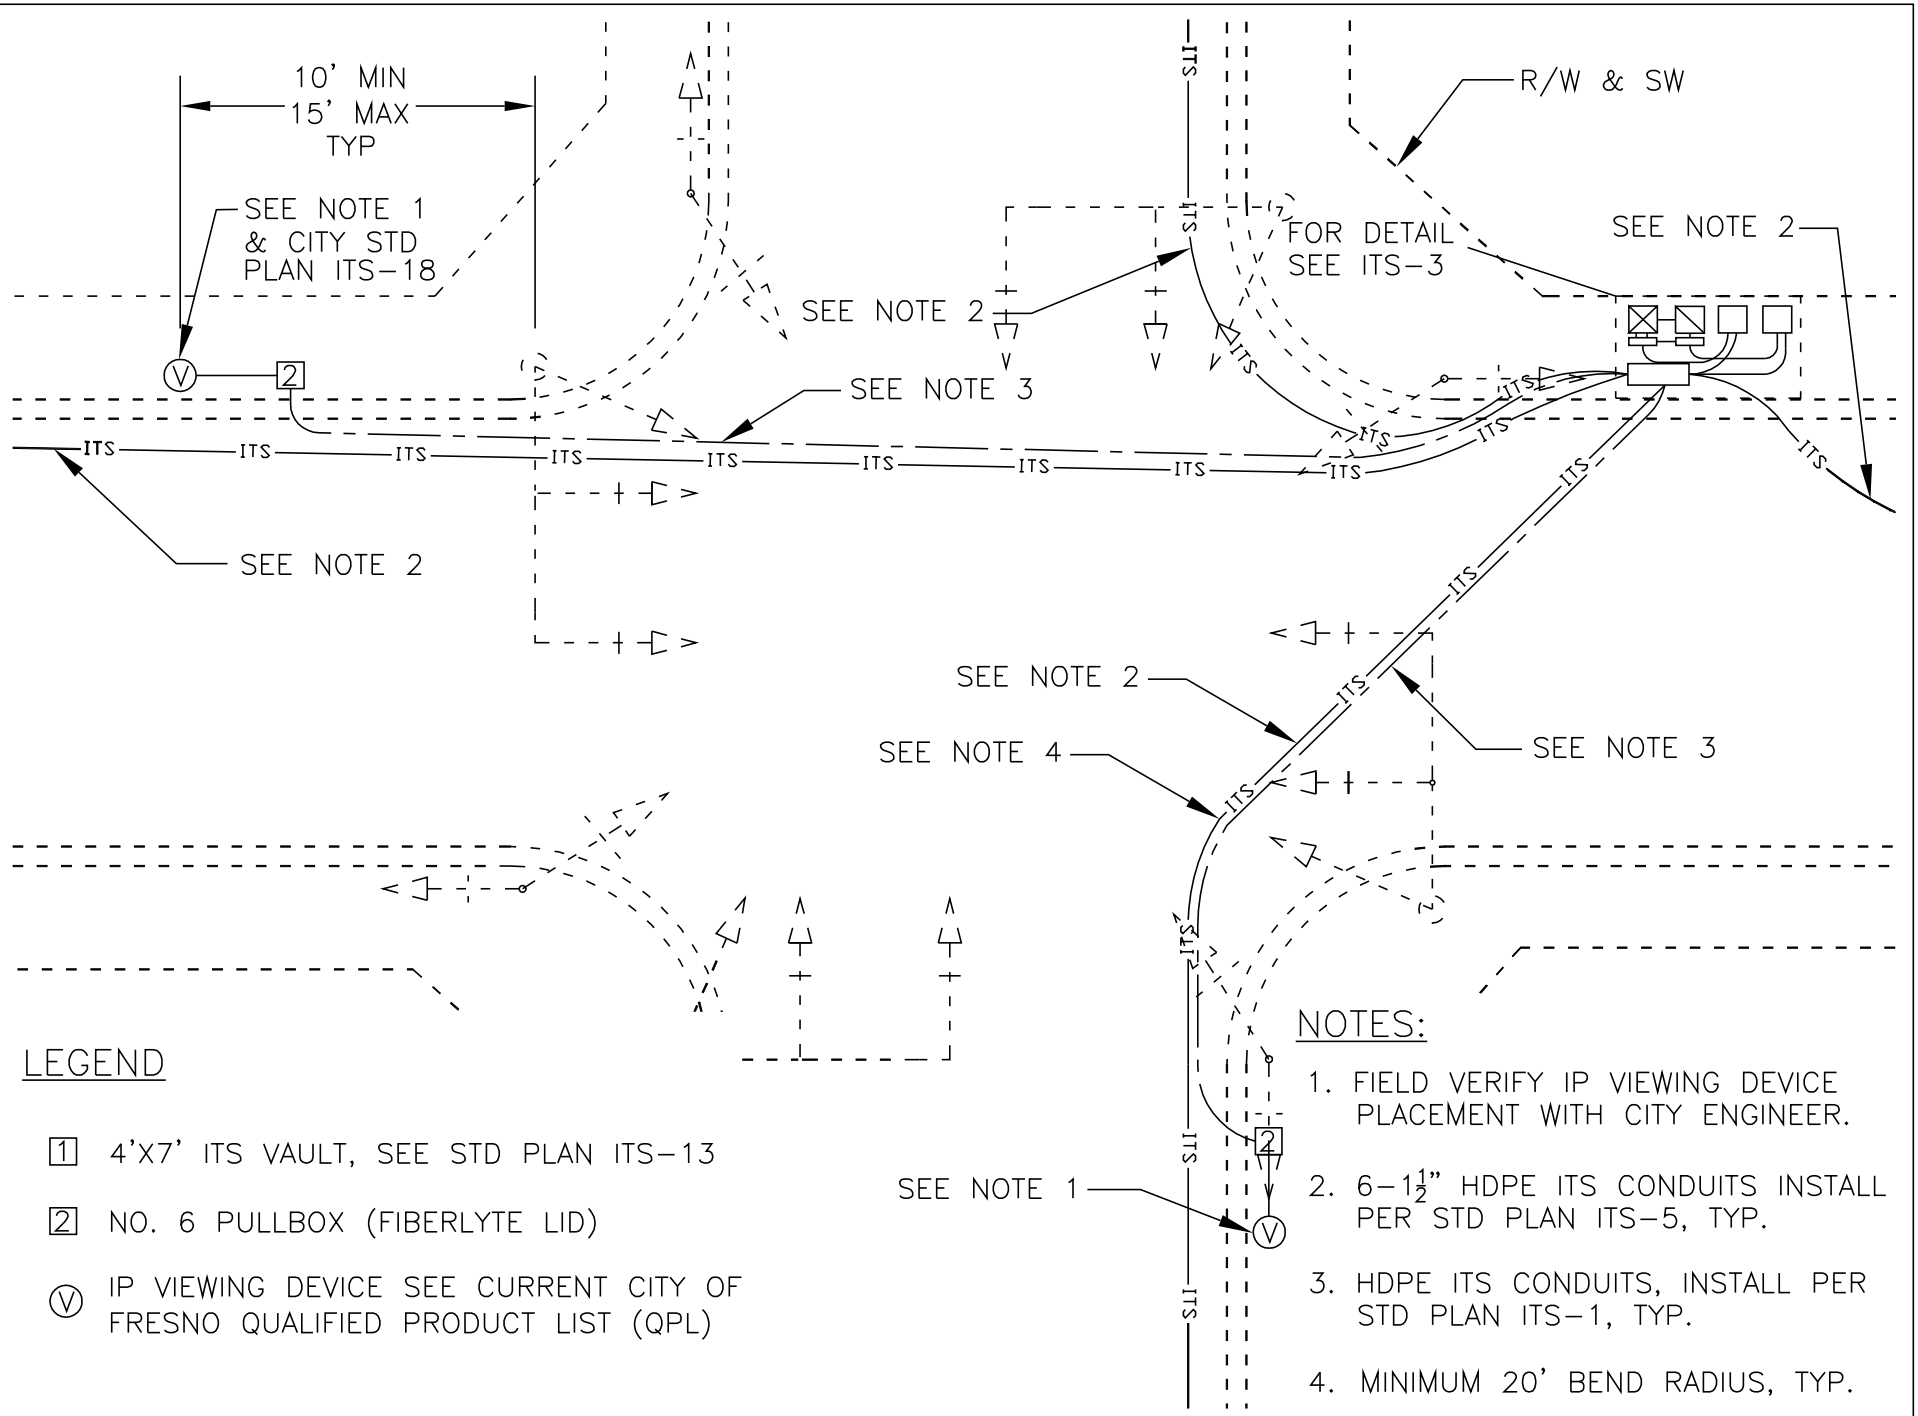

LEGEND

- [1] 4'X7' ITS VAULT, SEE STD PLAN ITS-13
- [2] NO. 6 PULLBOX (FIBERLYTE LID)
- (V) IP VIEWING DEVICE SEE CURRENT CITY OF FRESNO QUALIFIED PRODUCT LIST (QPL)

NOTES:

1. FIELD VERIFY IP VIEWING DEVICE PLACEMENT WITH CITY ENGINEER.
2. 6-1½" HDPE ITS CONDUITS INSTALL PER STD PLAN ITS-5, TYP.
3. HDPE ITS CONDUITS, INSTALL PER STD PLAN ITS-1, TYP.
4. MINIMUM 20' BEND RADIUS, TYP.

REF. & REV.
FEB 08

CITY OF FRESNO
ITS-2